


Hotel / Casino : Nevada, USA

3/18/2010 8:57:41 AM - 3/18/2010 9:17:56 AM

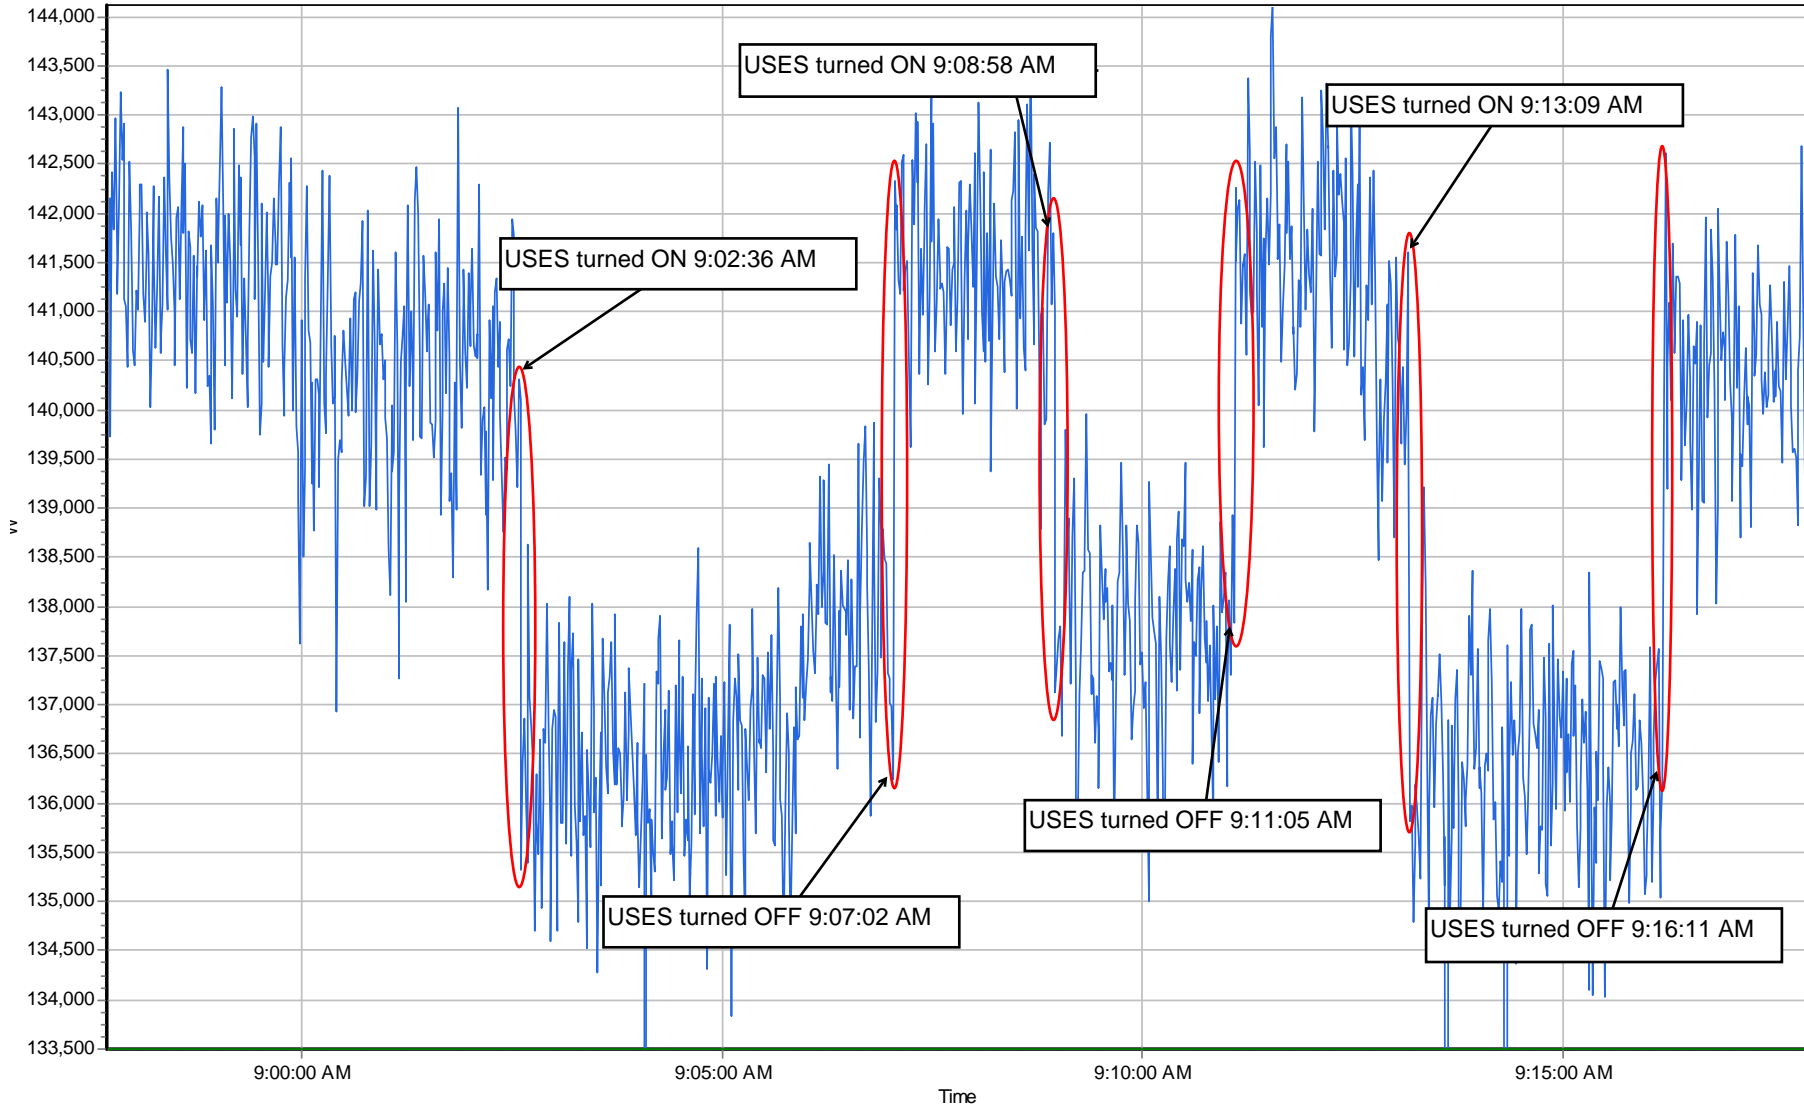

Real Power Total (141049.06 W; min:89086.70 W; max:144115.64 W; avg:138922.17 W)

Hotel / Casino : Nevada, USA


3/18/2010 8:57:41 AM - 3/18/2010 9:17:56 AM



Apparent Power Total (149391.11 VA, min:89106.56 VA; max:150806.88 VA; avg:142537.40 VA)

Hotel / Casino : Nevada, USA


3/18/2010 8:57:41 AM - 3/18/2010 9:17:56 AM

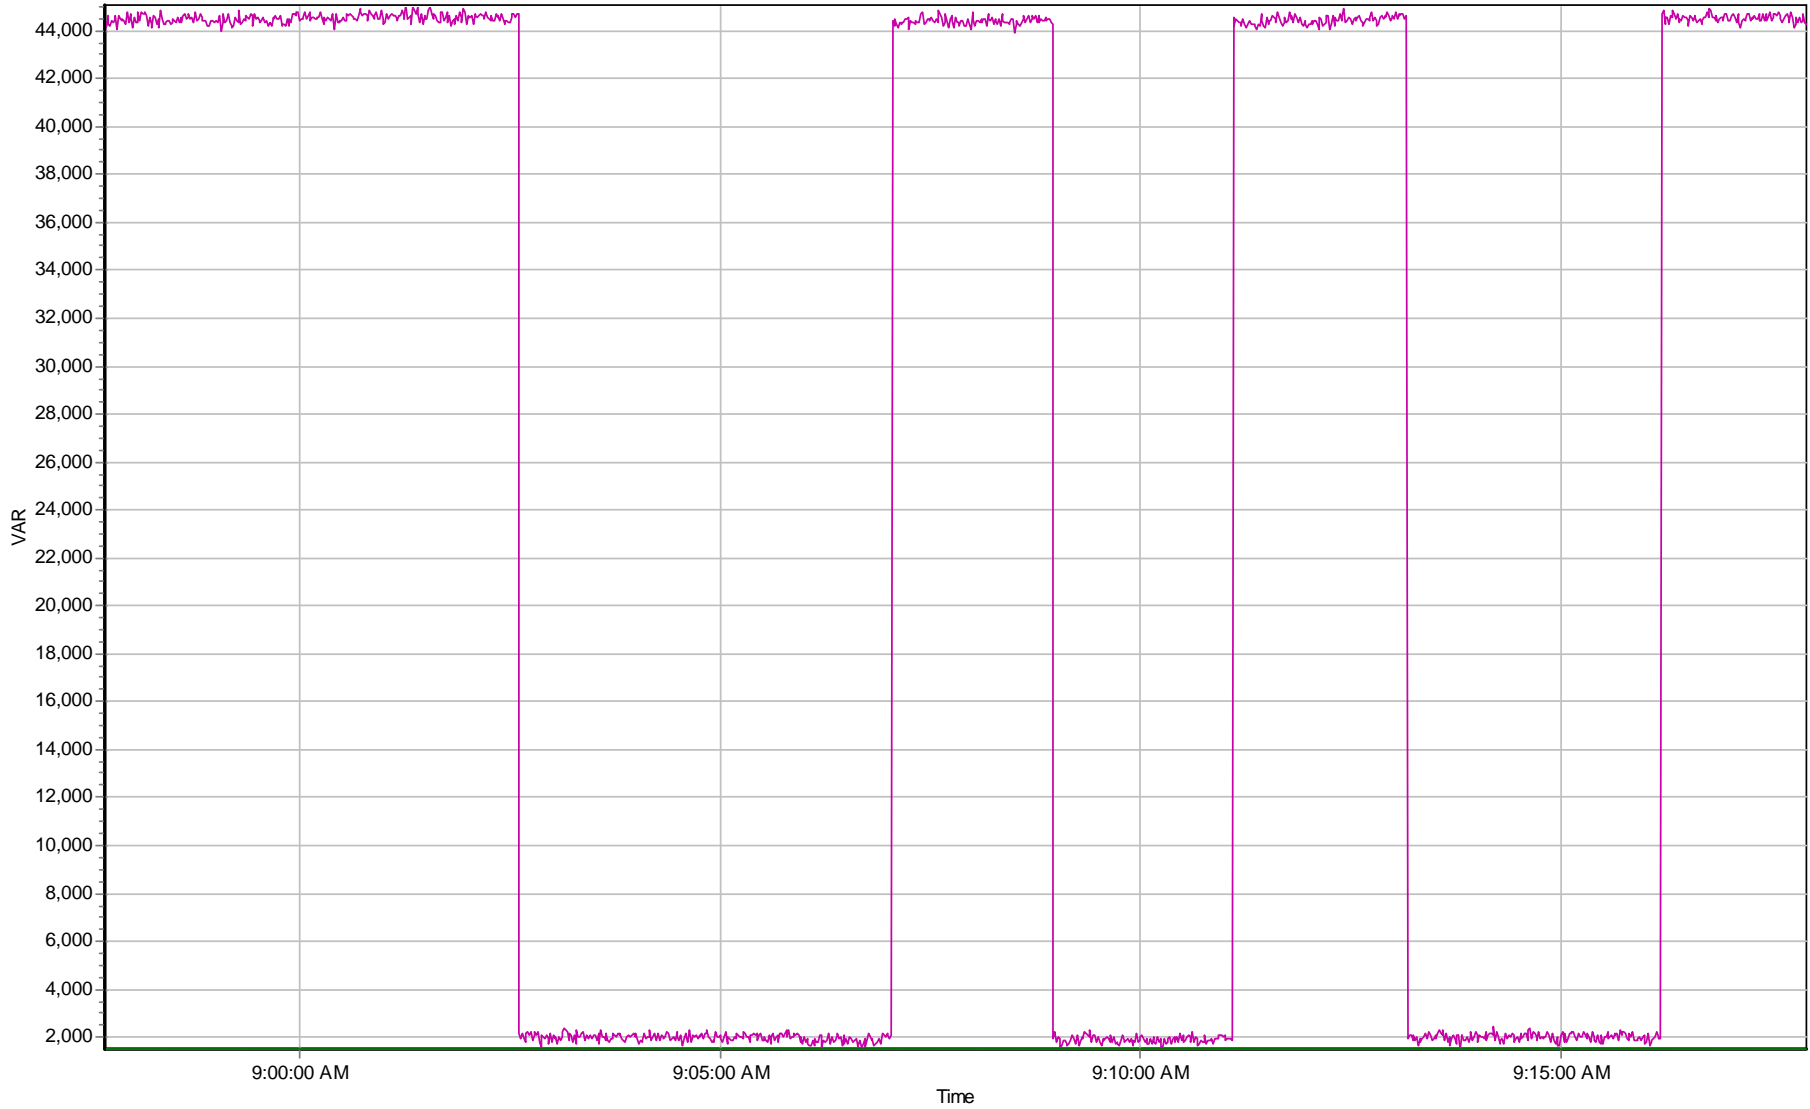

Reactive Power Total (44080.16 VAR, min:1508.64 VAR, max:45064.77 VAR, avg:24363.16 VAR)

Hotel / Casino : Nevada, USA


3/18/2010 8:57:41 AM - 3/18/2010 9:17:56 AM

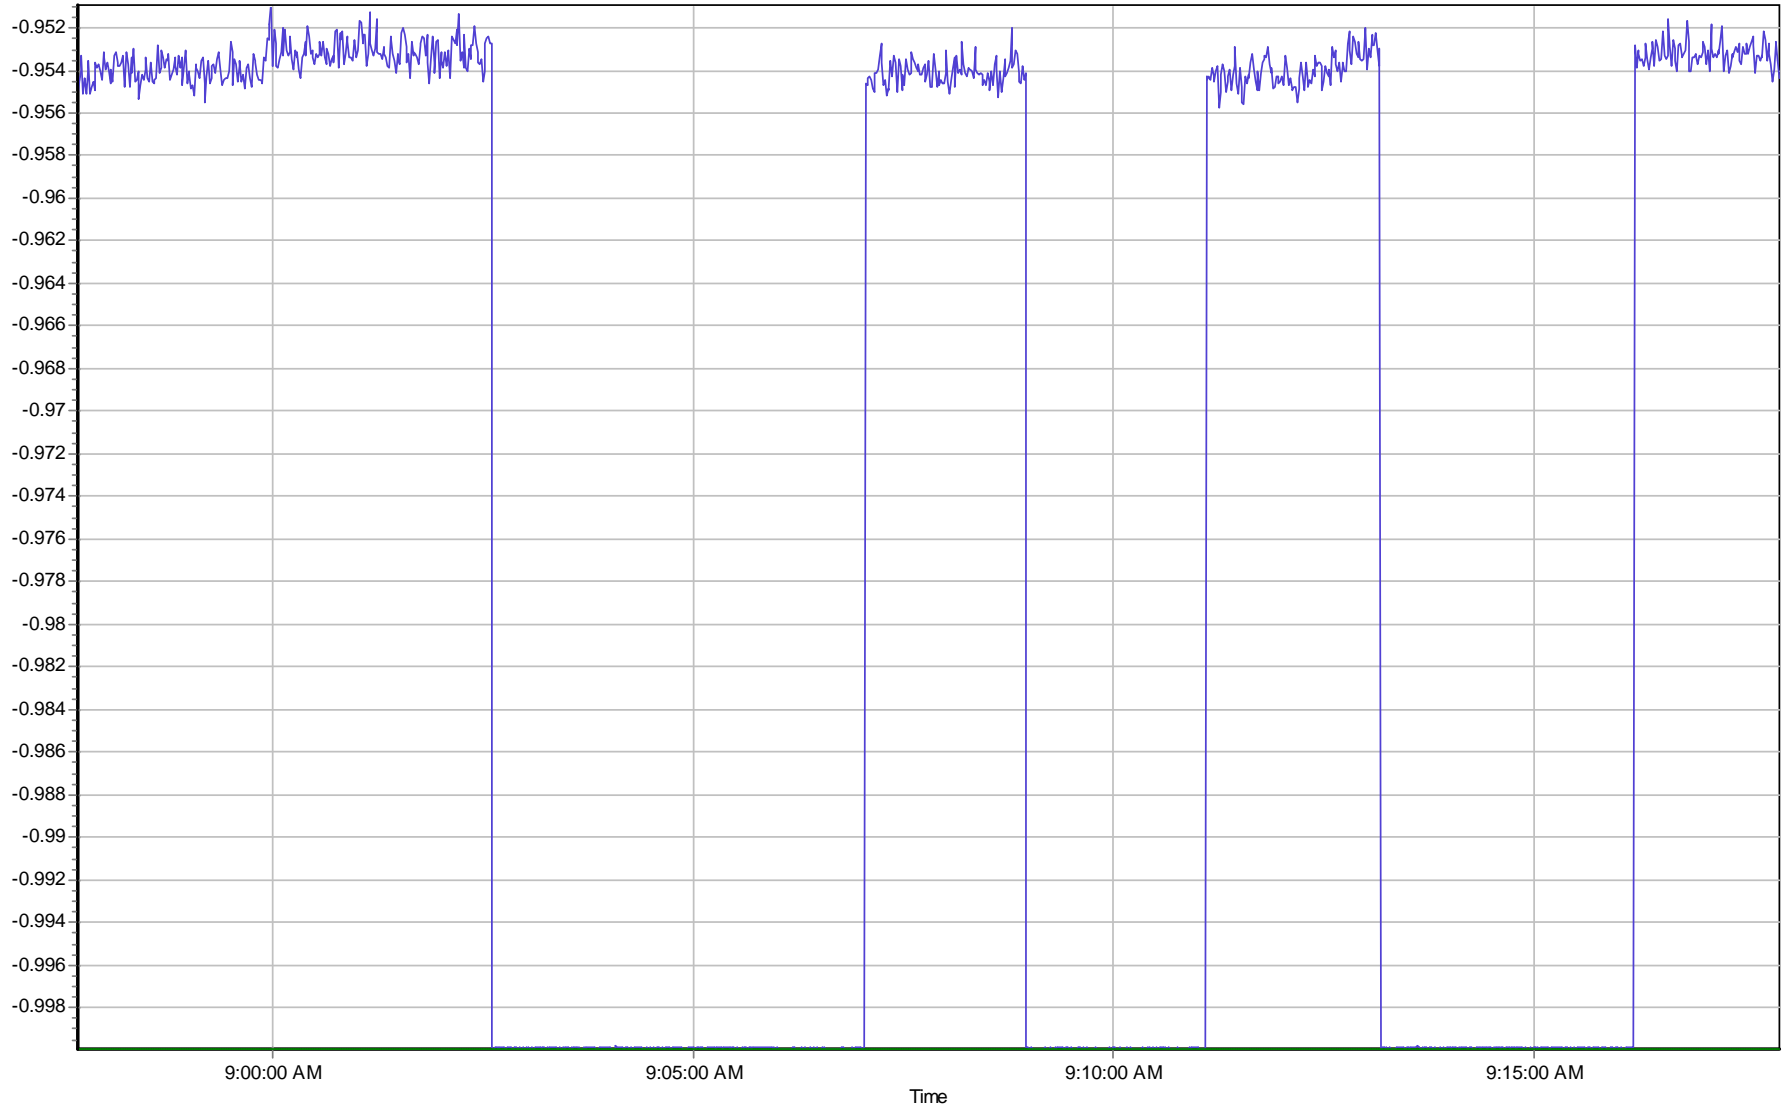

True Power Factor Total (0.96i, min:1.00i; max:0.95i; avg:0.98i)

Hotel / Casino : Nevada, USA


3/18/2010 8:57:41 AM - 3/18/2010 9:17:56 AM

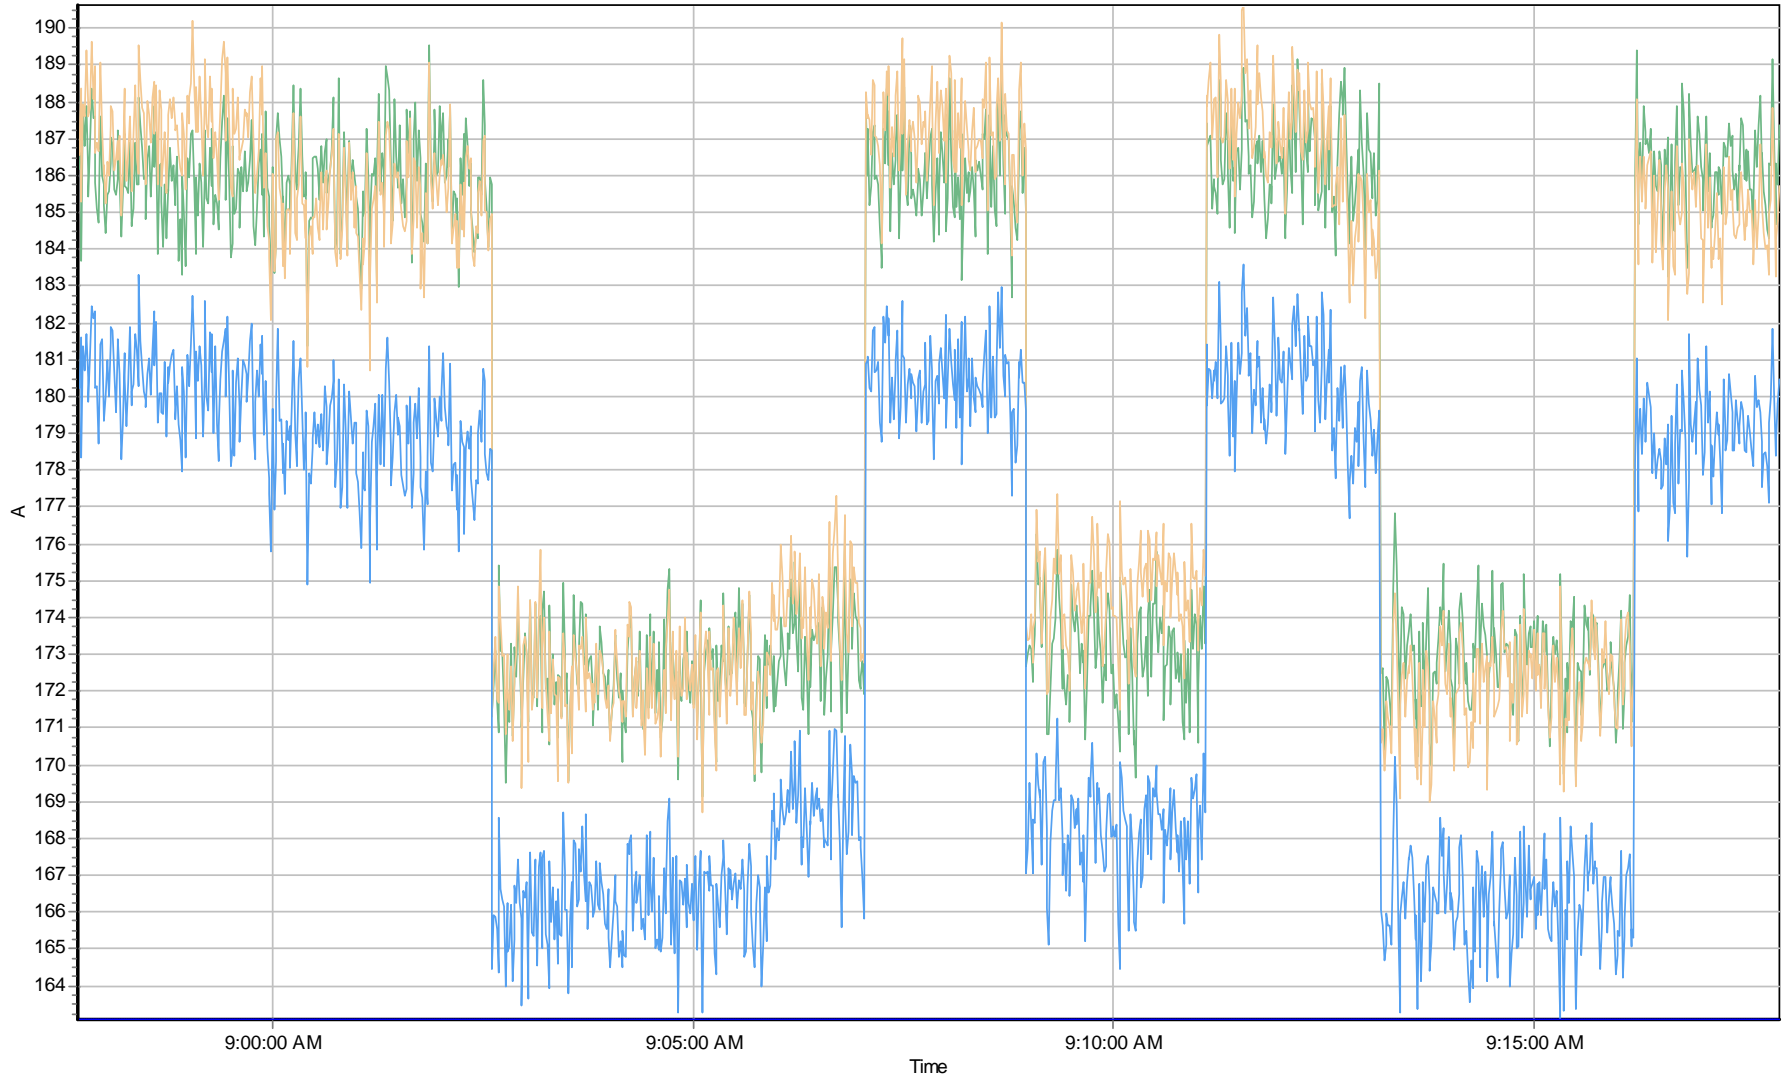

RMS Current Ø1 (185.98 A, min:169.11 A; max:189.55 A; avg:179.79 A) RMS Current Ø2 (187.25 A, min:168.72 A; max:190.62 A; avg:180.00 A)
 RMS Current Ø3 (181.57 A, min:163.08 A; max:183.60 A; avg:173.69 A)

Hotel / Casino : Nevada, USA

3/18/2010 8:57:41 AM - 3/18/2010 9:17:56 AM

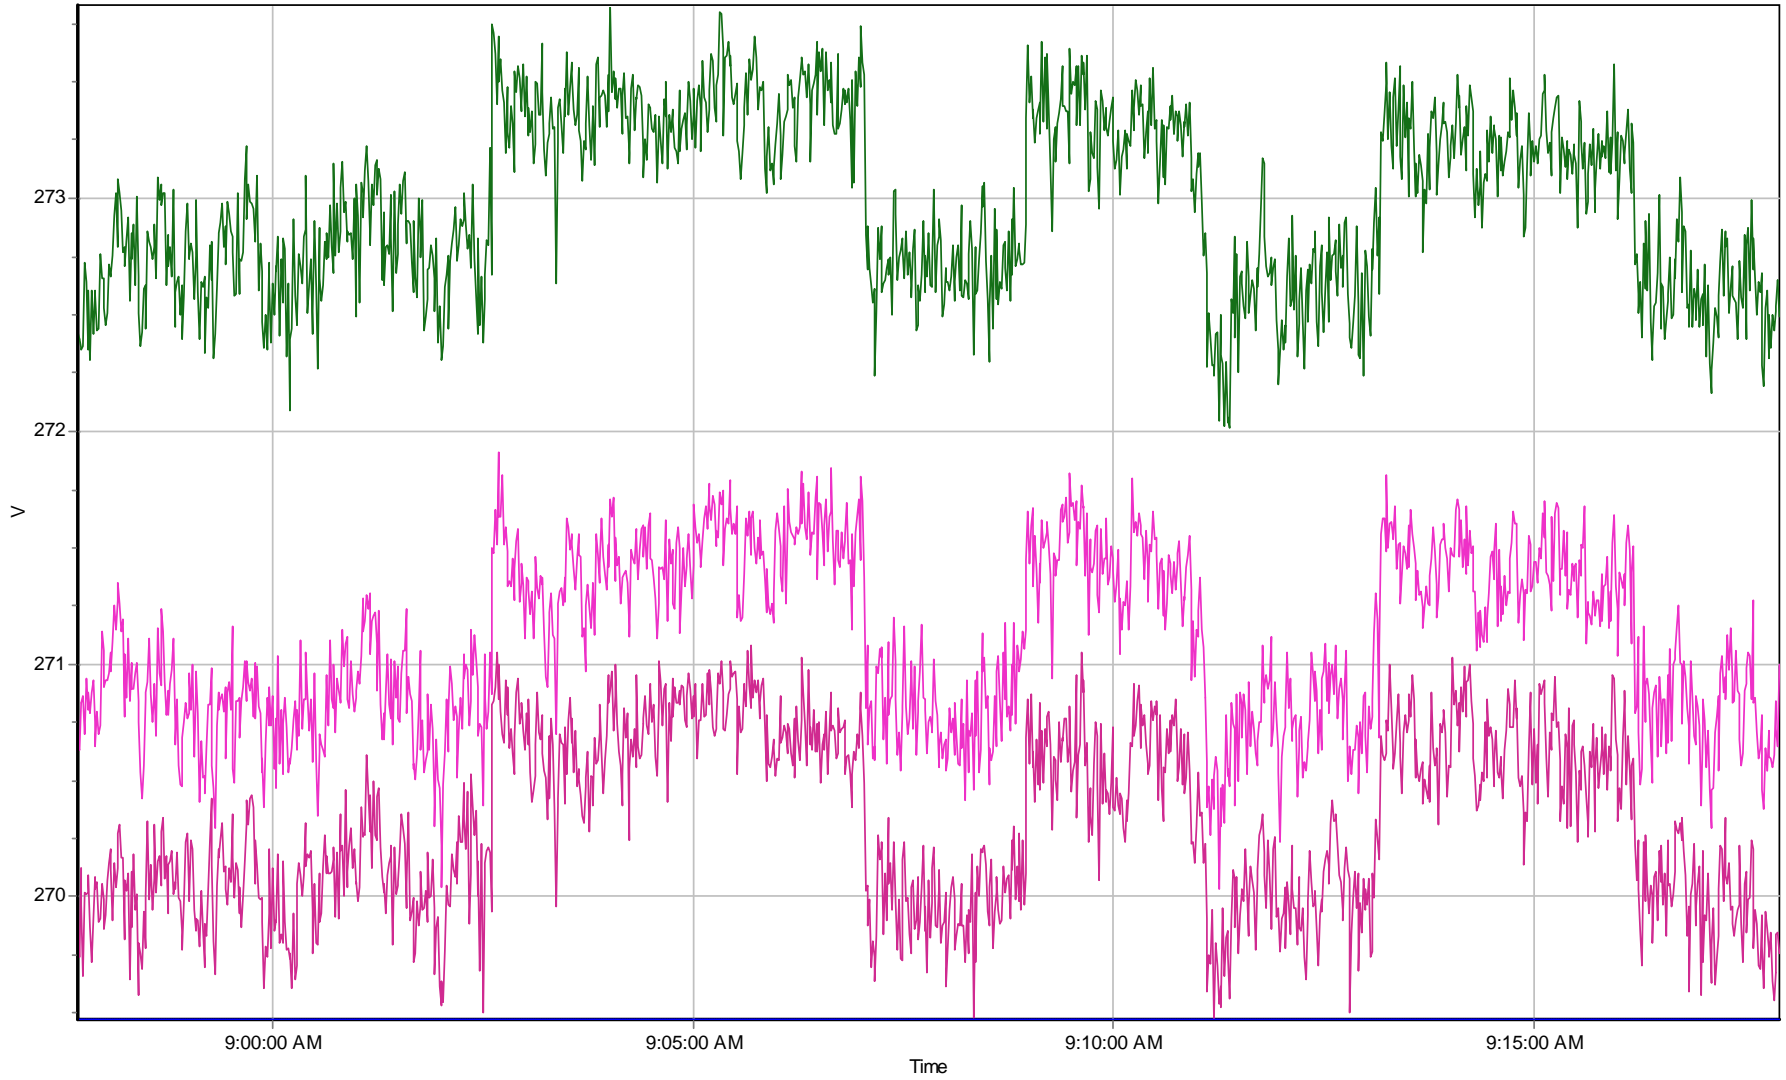

RMS Voltage Ø1 (273.02 V, min:272.01 V; max:273.83 V; avg:272.98 V) RMS Voltage Ø2 (270.08 V, min:269.47 V; max:271.08 V; avg:270.32 V)
 RMS Voltage Ø3 (270.92 V, min:270.03 V; max:271.91 V; avg:271.10 V)